

Accessibility Evaluation

Monroe County Polling Location



Binford Elementary
2300 E 2nd St
Bloomington, IN 47401

Inspection Date: 03/13/2026
Inspectors: Michael Bird, Annabelle Vosmeier

Prepared By
Monroe County
(916) 473 - 9444

Report Date: 04/06/2026

Table of Contents

Findings	3
Exterior	3
Path of Travel	3
Interior	5
Door	5

Exterior: Path of Travel

Finding: 1

The curb ramp does not seem to be visually compliant.

Curb ramps shall have a maximum running slope of 8.33% and a maximum cross slope of 2%. The counter slope at the adjoining gutter/road surface shall be 5% maximum. The transition between the ramp and the gutter/street shall be free of any changes in level. If flared sides are provided they shall have a maximum slope of 10%.

Curb ramps shall not project into the vehicular traffic lanes, parking spaces, or parking access aisles. If a marked crossing is provided the curb ramp shall be wholly contained within the markings. Diagonal curb ramps shall have a 48 inch clear space minimum outside the traffic lanes. If markings are provided the 48 inch clear space shall be within the markings and flared sides shall have a segment of curb 24 inches long minimum on each side of the curb ramp within the marked crossing.

2010 ADAS Section 406.1

Curb ramps on accessible routes shall comply with 406, 405.2 through 405.5, and 405.10.

Citation:


2010 ADAS Section: 406.1

Recommendation:

Recommend adding signage to direct voters to a more compliant curb ramp and a nearer door.



Finding: 1 Additional Finding Photos

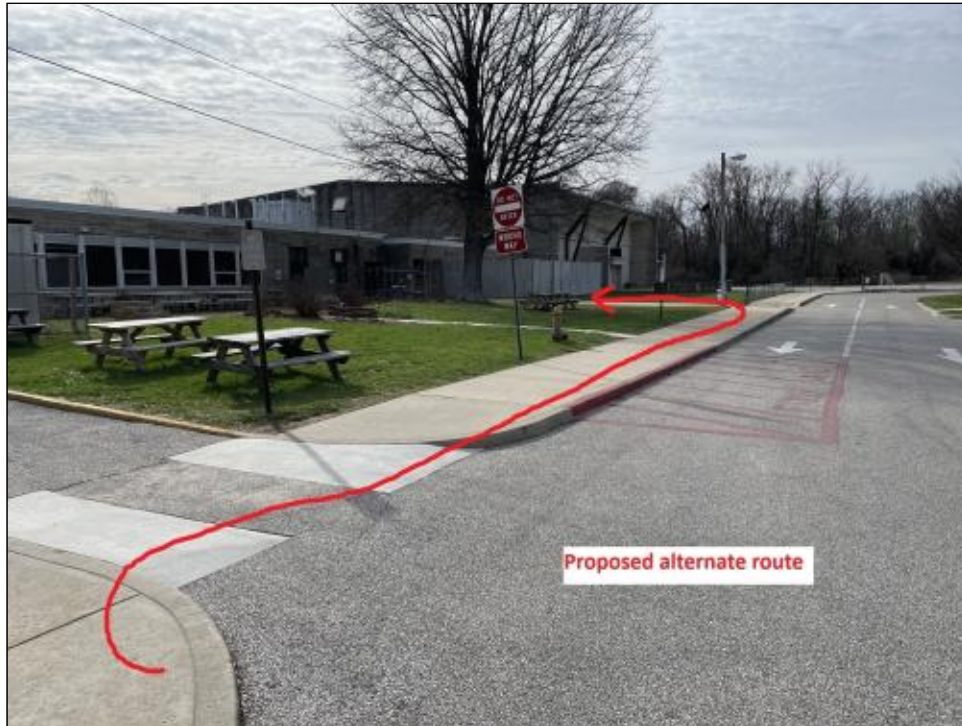

Interior: Door

Finding: 2

The door exceeds the maximum allowable opening force.

Interior doors shall have a maximum opening force of 5 pounds.

These forces do not apply to the force required to retract latch bolts or disengage other devices that hold the door or gate in a closed position.

2010 ADAS Section 404.2.9

Fire doors shall have a minimum opening force allowable by the appropriate administrative authority. The force for pushing or pulling open a door or gate other than fire doors shall be as follows: 1. Interior hinged doors and gates: 5 pounds (22.2 N) maximum. 2. Sliding or folding doors: 5 pounds (22.2 N) maximum. These forces do not apply to the force required to retract latch bolts or disengage other devices that hold the door or gate in a closed position.

Citation:

2010 ADAS Section: 404.2.9

Recommendation:

Recommend propping open door during voting.

