

Accessibility Evaluation

Monroe County Polling Location



Emmanuel Church
1503 W That Rd
Bloomington, IN 47403
Accessibility Evaluation
Inspection Date: 03/06/2026
Inspectors: Chris Jackson

Prepared By
Monroe County
(916) 473 - 9444

Report Date: 04/07/2026

Table of Contents

Findings	3
Exterior	3
Parking	3
Interior	6
Side Door	6
Restrooms	8

Exterior: Parking

Finding: 1

The access aisle is not located on an accessible route of travel to the accessible building entrance.

Accessible parking spaces serving a particular building shall be located on the shortest accessible route of travel from parking to an accessible entrance. In buildings with multiple accessible entrances with adjacent parking, accessible parking spaces shall be dispersed and located closest to the accessible entrances.

2010 ADAS Section 208.3.1

Parking spaces complying with 502 that serve a particular building or facility shall be located on the shortest accessible route from parking to an entrance complying with 206.4. Where parking serves more than one accessible entrance, parking spaces complying with 502 shall be dispersed and located on the shortest accessible route to the accessible entrances. In parking facilities that do not serve a particular building or facility, parking spaces complying with 502 shall be located on the shortest accessible route to an accessible pedestrian entrance of the parking facility.

2010 ADAS Section 502.3


Access aisles serving parking spaces shall comply with 502.3. Access aisles shall adjoin an accessible route. Two parking spaces shall be permitted to share a common access aisle.

Citation:

2010 ADAS Section: 208.3.1, 502.3

Recommendation:

Add cones to create a 36" wide protected path of travel along the curb leading to the entrance. (See additional photograph for example cone placement.)

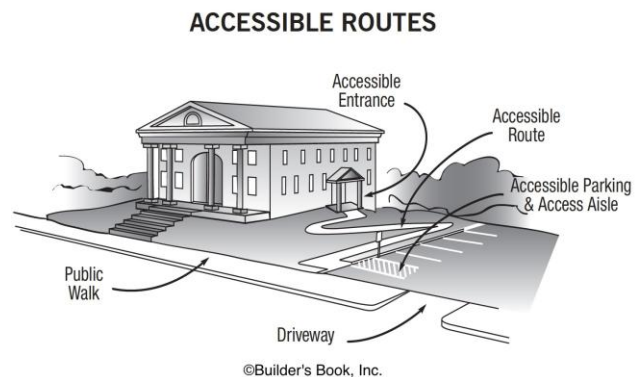

Finding: 1 Additional Finding Photos



Exterior: Parking

Finding: 2

The van space is missing the required van identification sign.

Parking space identification signs shall include the International Symbol of Accessibility. Signs identifying van parking spaces shall contain the designation "van accessible."

2010 ADAS Section 502.6

Parking space identification signs shall include the International Symbol of Accessibility complying with 703.7.2.1. Signs identifying van parking spaces shall contain the designation "van accessible." Signs shall be 60 inches (1525 mm) minimum above the finish floor or ground surface measured to the bottom of the sign.

Citation:

2010 ADAS Section: 502.6

Recommendation:

Add temporary or permanent accessible parking signage to each accessible space. Add temporary or permanent "van accessible" parking signage to at least one space.



Interior: Side Door

Finding: 3

The threshold is greater than 1/2 inch high.

The threshold at a doorway shall be no higher than 1/2 inch. Changes in level between 1/4 inch and 1/2 inch must be beveled at 1:2 or less. 1/4 inch is the maximum vertical rise.

2010 ADAS Section 404.2.5

Thresholds, if provided at doorways, shall be 1/2 inch (13 mm) high maximum. Raised thresholds and changes in level at doorways shall comply with 302 and 303.


Citation:

2010 ADAS Section: 404.2.5

Recommendation:

Use primary front door instead of side door and have a poll worker or appropriate signage direct voters through double doors into the gymnasium space. (See additional photograph for alternate accessible route.)

If this door is used, add a threshold reducer.

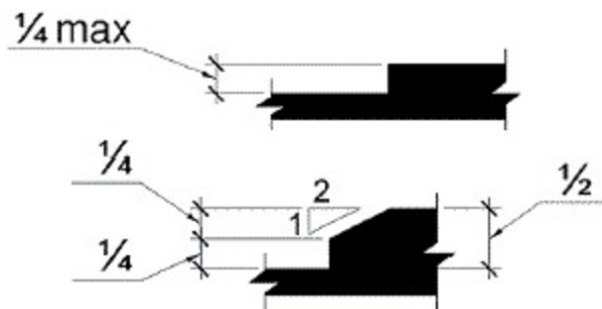

Finding: 3 Additional Finding Photos



Interior: Restrooms

Finding: 4

A compliant room identification sign is missing on the strike side of the door.

Wall signs identifying permanent rooms and spaces of a building shall be a horizontal format and the characters raised 1/32 inch minimum and shall be sans serif uppercase characters a minimum of 5/8 inch and a maximum of 2 inches high. Contracted Grade 2 Braille shall be in a horizontal format and shall be placed a minimum of 3/8 inch and a maximum of 1/2 inch directly below the tactile characters; flush left or centered. Signs with raised characters or Braille shall be located 48 inches minimum above the finish floor or ground surface, measured from the baseline of the lowest tactile character and 60 inches maximum above the finish floor or ground surface, measured from the baseline of the highest tactile character.

2010 ADAS Section 216.2

Interior and exterior signs identifying permanent rooms and spaces shall comply with 703.1, 703.2, and 703.5. Where pictograms are provided as designations of permanent interior rooms and spaces, the pictograms shall comply with 703.6 and shall have text descriptors complying with 703.2 and 703.5.

Citation:

2010 ADAS Section: 216.2

Recommendation:

Install temporary compliant signage identifying the type of restroom.

