

Accessibility Evaluation

Monroe County Polling Location



Harrodsburg Community Center
1002 W Popcorn Rd
Bloomington, IN 47403

Inspection Date: 03/24/2026

Inspectors: Michael Shermis, Annabelle Vosmeier

Prepared By
Monroe County
(916) 473 - 9444

Report Date: 04/07/2026

Table of Contents

Findings	3
Exterior	3
Parking	3
Path of Travel	4
Doors	6
Interior	7
Doors	7
Restrooms	8

Exterior: Parking

Finding: 1

There are no accessible parking spaces.

Each lot where parking is provided for the public as clients, guests or employees, shall provide accessible parking and shall be located on the shortest accessible route of travel from adjacent parking to an accessible entrance.

There are a total of 50 parking spaces in the parking lot that could be reasonably associated with this facility. There should be a minimum of 2 accessible spaces with a minimum of 1 being designed as van accessible.

2010 ADAS Section 208.2

Parking spaces complying with 502 shall be provided in accordance with Table 208.2 except as required by 208.2.1, 208.2.2, and 208.2.3. Where more than one parking facility is provided on a site, the number of accessible spaces provided on the site shall be calculated according to the number of spaces required for each parking facility.

Citation:

2010 ADAS Section: 208.2

Recommendation:

Place signage designating two spaces as accessible and use cones to create an access aisle. See next finding for potential location of an access aisle.



Total Number of Parking Spaces Provided in Parking Facility	Minimum Number of Required Accessible Parking Spaces
1 to 25	1
26 to 50	2
51 to 75	3
76 to 100	4
101 to 150	5
151 to 200	6
201 to 300	7
301 to 400	8
401 to 500	9
501 to 1000	2 percent of total
1001 and over	20, plus 1 for each 100, or fraction thereof, over 1000

Exterior: Path of Travel

Finding: 2

The walkway contains changes in level greater than a 1/2 inch high that should be ramped.

Changes in level greater than 1/2 inch high shall be constructed as a ramp or curb ramp.

2010 ADAS Section 303.4

Changes in level greater than 1/2 inch (13 mm) high shall be ramped, and shall comply with 405 or 406.

Citation:

2010 ADAS Section: 303.4

Recommendation:

Consider placing accessible spaces at the end of the sidewalk, where the curb is lowest, and creating an access aisle there. Use temporary signage to indicate the accessible parking spaces and cones/strings to create the access aisle.



Finding: 2 Additional Finding Photos



Exterior: Doors

Finding: 3

The threshold is greater than 1/2 inch high on the exterior side of the door.

The threshold at a doorway shall be no higher than 1/2 inch. Changes in level between 1/4 inch and 1/2 inch must be beveled at 1:2 or less. 1/4 inch is the maximum vertical rise.

2010 ADAS Section 404.2.5


Thresholds, if provided at doorways, shall be 1/2 inch (13 mm) high maximum. Raised thresholds and changes in level at doorways shall comply with 302 and 303.

Citation:

2010 ADAS Section: 404.2.5

Recommendation:

Add a temporary or permanent threshold reducer.

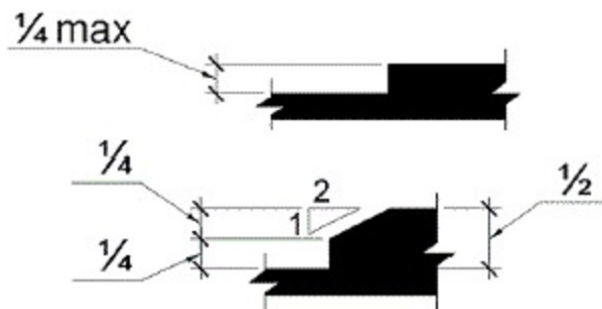

Interior: Doors

Finding: 4

The threshold is greater than 1/2 inch high on the interior side of the door.

The threshold at a doorway shall be no higher than 1/2 inch. Changes in level between 1/4 inch and 1/2 inch must be beveled at 1:2 or less. 1/4 inch is the maximum vertical rise.

2010 ADAS Section 404.2.5


Thresholds, if provided at doorways, shall be 1/2 inch (13 mm) high maximum. Raised thresholds and changes in level at doorways shall comply with 302 and 303.

Citation:

2010 ADAS Section: 404.2.5

Recommendation:

Add a temporary or permanent threshold reducer.

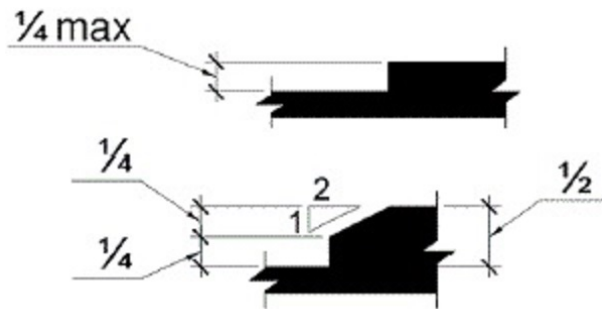

Interior: Restrooms

Finding: 5

An accessible toilet compartment is not provided.

Where toilet compartments are provided, at least one toilet compartment shall comply. In addition at least one compartment shall be designed for ambulatory use where six or more toilet compartments are provided, or where the combination of urinals and water closets totals six or more fixtures.

2010 ADAS Section 213.3.1

Where toilet compartments are provided, at least one toilet compartment shall comply with 604.8.1. In addition to the compartment required to comply with 604.8.1, at least one compartment shall comply with 604.8.2 where six or more toilet compartments are provided, or where the combination of urinals and water closets totals six or more fixtures.

Citation:

2010 ADAS Section: 213.3.1

Recommendation:

Place signage informing voters that accessible restrooms are not available and directing voters with disabilities to the front of the line. Alternatively, place an accessible portable restroom outside.



Finding: 5 Additional Finding Photos



Interior: Restrooms

Finding: 6

A compliant room identification sign is missing on the strike side of the door.

Wall signs identifying permanent rooms and spaces of a building shall be a horizontal format and the characters raised 1/32 inch minimum and shall be sans serif uppercase characters a minimum of 5/8 inch and a maximum of 2 inches high. Contracted Grade 2 Braille shall be in a horizontal format and shall be placed a minimum of 3/8 inch and a maximum of 1/2 inch directly below the tactile characters; flush left or centered. Signs with raised characters or Braille shall be located 48 inches minimum above the finish floor or ground surface, measured from the baseline of the lowest tactile character and 60 inches maximum above the finish floor or ground surface, measured from the baseline of the highest tactile character.

2010 ADAS Section 216.2

Interior and exterior signs identifying permanent rooms and spaces shall comply with 703.1, 703.2, and 703.5. Where pictograms are provided as designations of permanent interior rooms and spaces, the pictograms shall comply with 703.6 and shall have text descriptors complying with 703.2 and 703.5.

Citation:

2010 ADAS Section: 216.2

Recommendation:

Install temporary compliant signage identifying the type of restroom.

